



**INPUT CONTROL**  
 THREE WIRES FROM NO. 4444 TOUCH SWITCH.  
 IF CONTACT TYPE SWITCH IS USED, CONNECT SWITCH  
 ACROSS WHT & BLK TERMINALS.  
 IF MORE THAN ONE INPUT SWITCH IS USED FOR  
 CONTROL, CONNECT SWITCHES IN PARALLEL.  
 IF TWO 4300 UNITS ARE TO BE OPERATED  
 SIMULTANEOUSLY, CONNECT INPUT CONTROLS IN  
 PARALLEL.


CIRCUIT BOARD CONNECTIONS AND ADJUSTMENTS

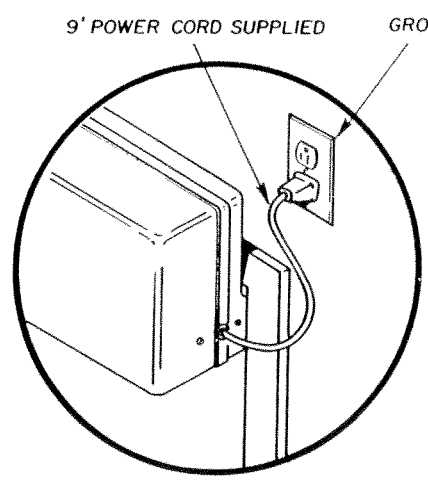

115VOLT WIRING

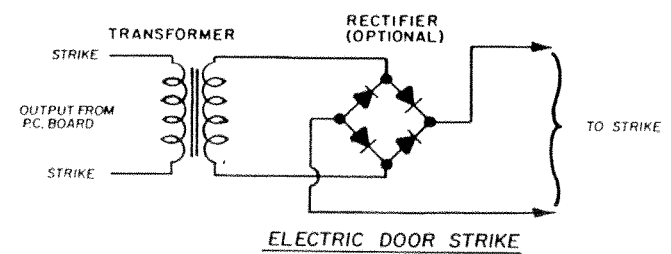

INTERNAL WIRING

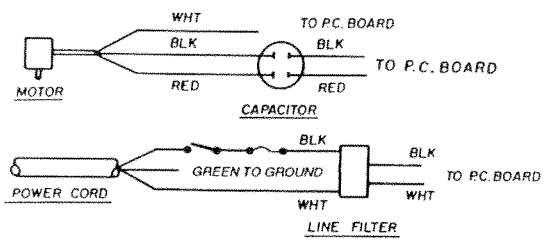

	<b>POWER ACCESS</b> CORPORATION
	<b>ELECTRICAL DETAILS</b>
	<b>MODEL 4300</b>
3/94	4265D